


SERVICE INSTALLATIONS

UNDERGROUND SERVICES GENERAL

1. MUST BE LOCATED BY THE COMMISSION PRIOR TO WIRING INSTALLATION
2. METER BASE AND MINIMUM 2" CONDUIT RISER ARE TO BE INSTALLED BY OWNER

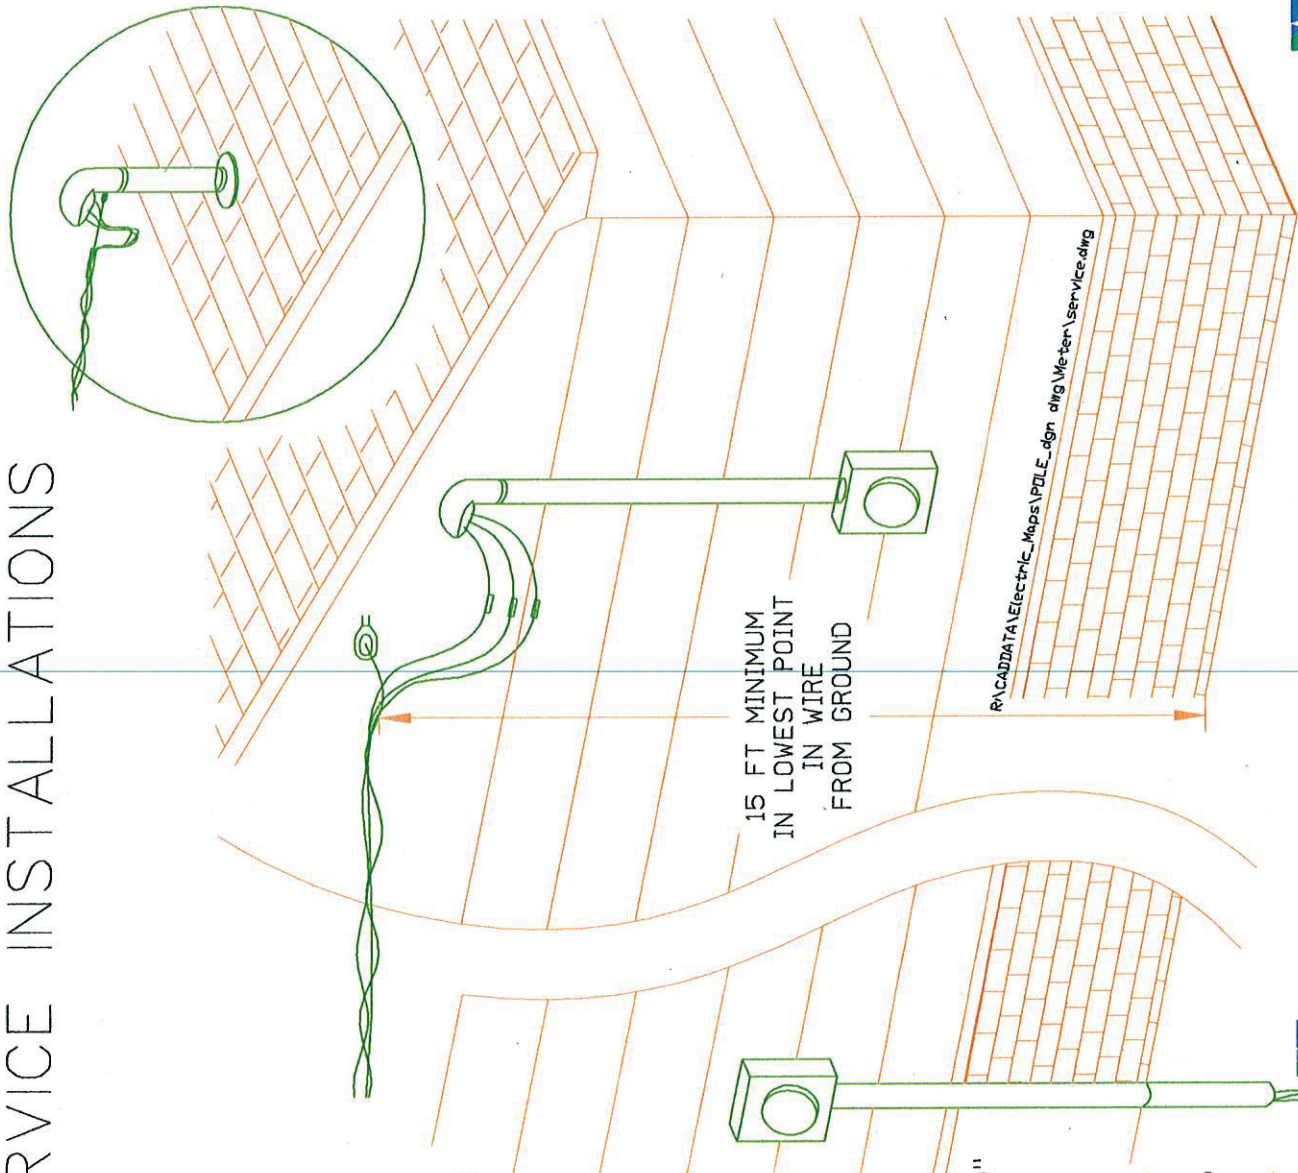

OVERHEAD SERVICES GENERAL

1. MUST BE LOCATED BY THE COMMISSION PRIOR TO WIRING INSTALLATION
2. METER BASE, SERVICE ENTRANCE RISER AND POINT OF ATTACHMENT ARE TO BE INSTALLED BY OWNER.
3. MINIMUM ACCEPTABLE POINT OF ATTACHMENT MUST BE A 3" GALV. EYE BOLT THROUGH STRUCTURAL MEMBER




FOR ADDITIONAL INFORMATION OR INQUIRIES
PLEASE CONTACT ELECTRIC ENGINEERING
@ (252)551-1582



NOTE:

45° BEND REQUIRED WHEN FOOTING PREVENTS VERTICAL CABLE ENTRY

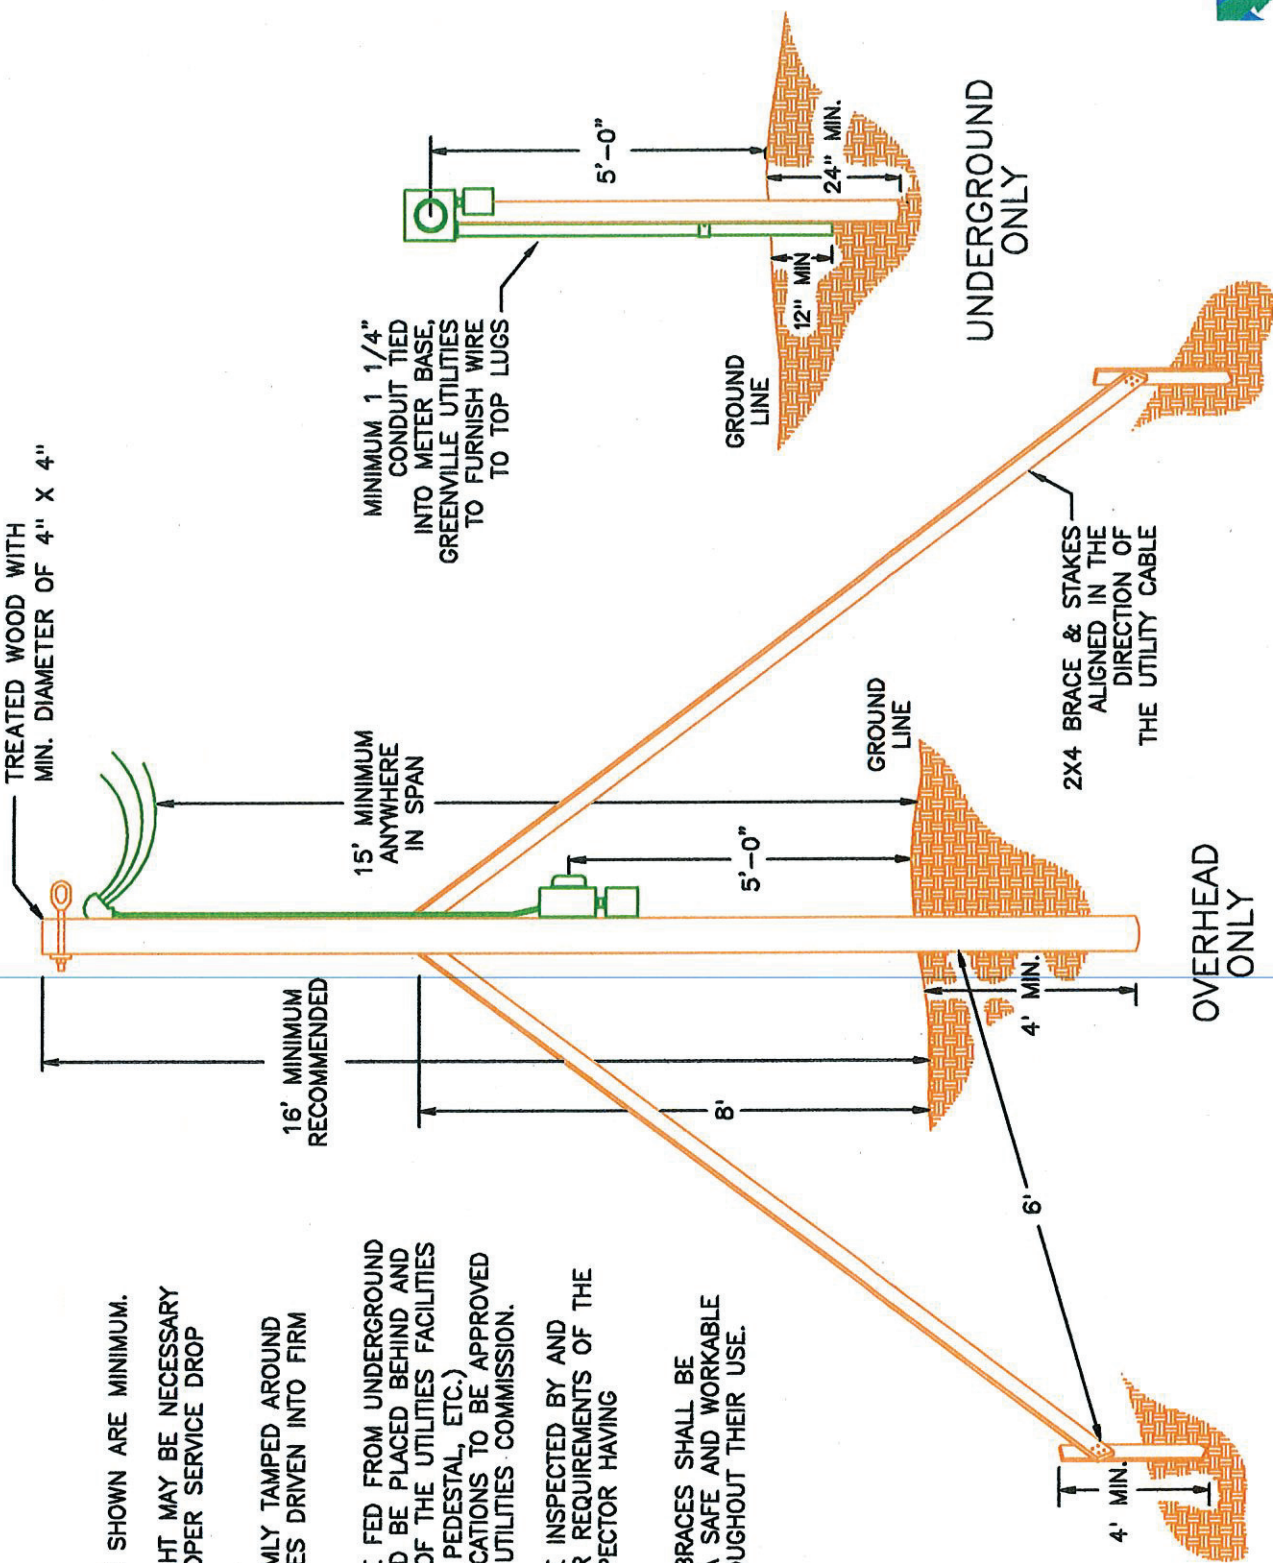

TYPICAL TEMPORARY SERVICE INSTALLATIONS ON GUC SYSTEM

GENERAL NOTES:

1. ALL DIMENSIONS SHOWN ARE MINIMUM.
2. ADDITIONAL HEIGHT MAY BE NECESSARY TO PROVIDE PROPER SERVICE DROP CLEARANCE.
3. SOIL TO BE FIRMLY TAMPED AROUND POLE AND STAKES DRIVEN INTO FIRM EARTH.
4. SERVICES TO BE FED FROM UNDERGROUND UTILITIES SHOULD BE PLACED BEHIND AND WITHIN 5 FEET OF THE UTILITIES FACILITIES (TRANSFORMER, PEDESTAL, ETC.) ALL SERVICE LOCATIONS TO BE APPROVED BY GREENVILLE UTILITIES COMMISSION.
5. SERVICES TO BE INSPECTED BY AND MEET ALL OTHER REQUIREMENTS OF THE ELECTRICAL INSPECTOR HAVING JURISDICTION.
6. SERVICES AND BRACES SHALL BE MAINTAINED IN A SAFE AND WORKABLE CONDITION THROUGHOUT THEIR USE.