



- NOTES:**

 1. All concrete to be 3,000 PSI compressive strength
 2. At all driveways, sidewalks to be removed to the nearest joint beyond new construction or cut with saw and removed. Saw cut or joint to be perpendicular to edge of existing pavement.
 3. All driveways must meet the current city driveway regulations and NCDOT requirements for spacing, sight distance, and offsets from property lines and intersections.
 4. Radii must be minimum 5 feet or the width of the planting strip, whichever is greater.
 5. Pavers used in driveway must have a thickness of 3 inches.
 6. Algebraic difference in grade ("A") between slopes shall be 8% or less.
 7. Special conditions may warrant exceptions to this detail. Subject to review by City Engineer.

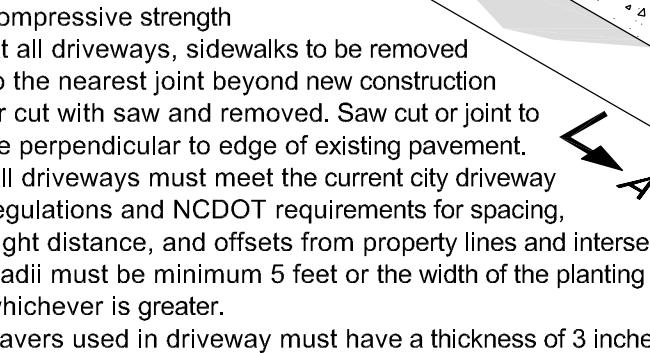

SECTION A-A

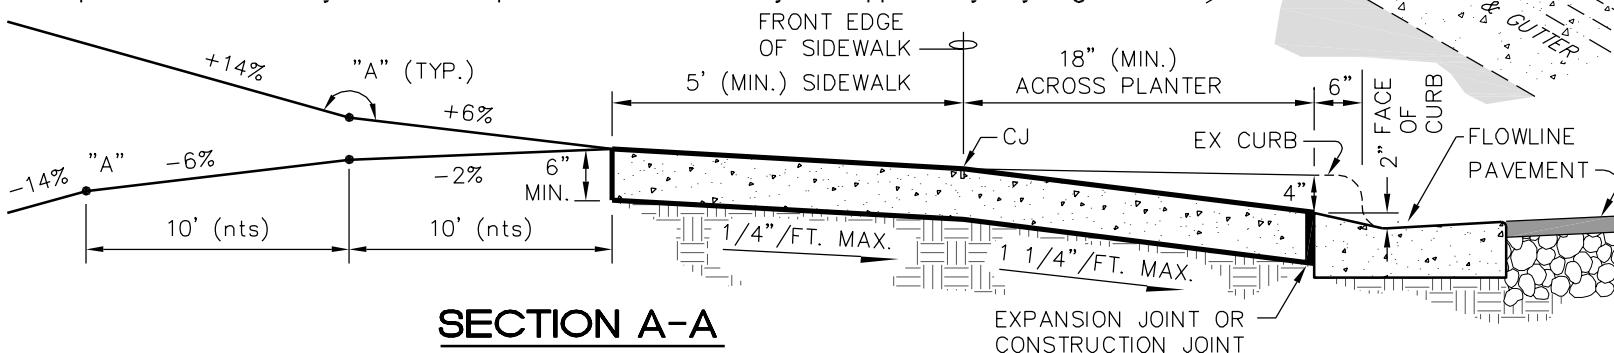

PUBLIC WORKS DEPARTMENT
1500 Beatty Street
Greenville, North Carolina 27834

CITY OF GREENVILLE, N.C.

USE WITH THE CITY OF GREENVILLE, N.C. STANDARD SPECIFICATIONS ONLY

www.greenvillenc.gov

No.	Date	Description
1	9/16/11	APPROVAL
Scale: not to scale	Sheet #: 1 of 1	Detail # 420.01