



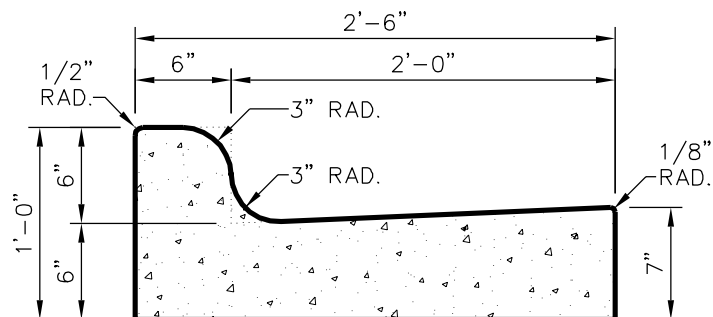


2'-6" CURB AND GUTTER

30" CURB AND GUTTER SHALL BE PLACED IN NCDOT R/W.

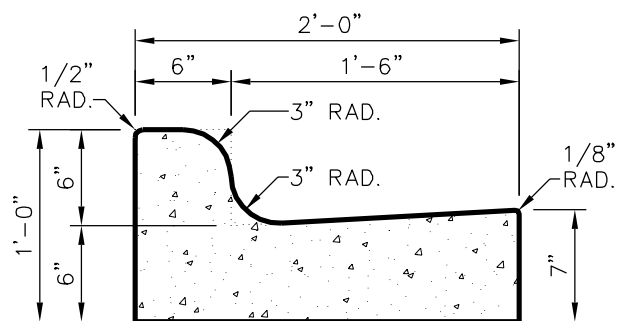


2'-0" CURB AND GUTTER

24" CURB AND GUTTER SHALL BE PLACED IN RESIDENTIAL DEVELOPMENTS OR AS PROVIDED IN SEC. 490 OF THIS MANUAL.

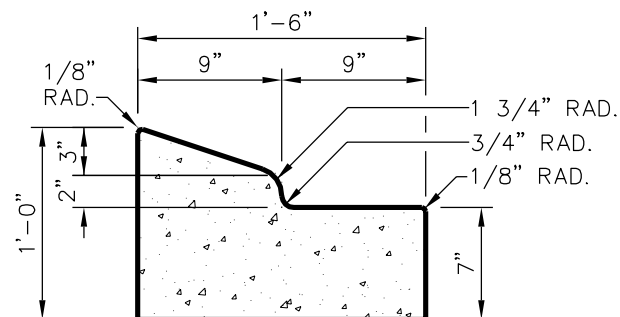

1'-6" CURB AND GUTTER

(TO BE USED IN MEDIANS ONLY)

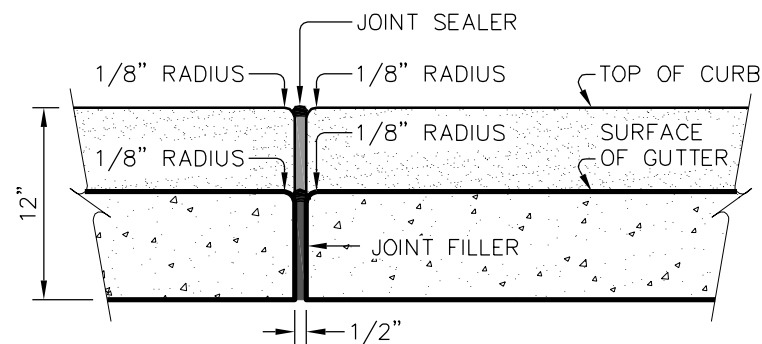

TRANSVERSE EXPANSION JOINT IN CURB AND GUTTER

NOTES:

1. Contraction joints shall be placed at 10' intervals, except that 15' spacing may be used when a machine is used or when satisfactory support for the face form can be obtained without the use of templates at 10' intervals. Joint spacing may be altered by the engineer to prevent uncontrolled cracking.
2. Contraction joints may be installed by the use of templates or formed by other approved methods. Where such joints are not formed by templates, a minimum depth of 1 1/2" shall be obtained.
3. All contraction joints shall be filled with joint filler.
4. Expansion joints shall be spaced at 90' intervals, and adjacent to all rigid objects.
5. All curb and gutters are to be poured with class "A" concrete (3,000 PSI).
6. Flexible forms are to be used when radius is less than 200'.



PUBLIC WORKS DEPARTMENT
1500 Beatty Street
Greenville, North Carolina 27834

CITY OF GREENVILLE, N.C.

USE WITH THE CITY OF GREENVILLE, N.C. STANDARD SPECIFICATIONS ONLY

www.greenvillenc.gov

No.	Date	Description
1	9/16/11	APPROVAL
Scale:	Sheet #:	Detail #:
not to scale	1 of 1	411.01

STANDARD CURB & GUTTER